



HYDROCARBONS, OILS, GRIT AND SAND (HOGS) WASTEWATER INTERCEPTOR

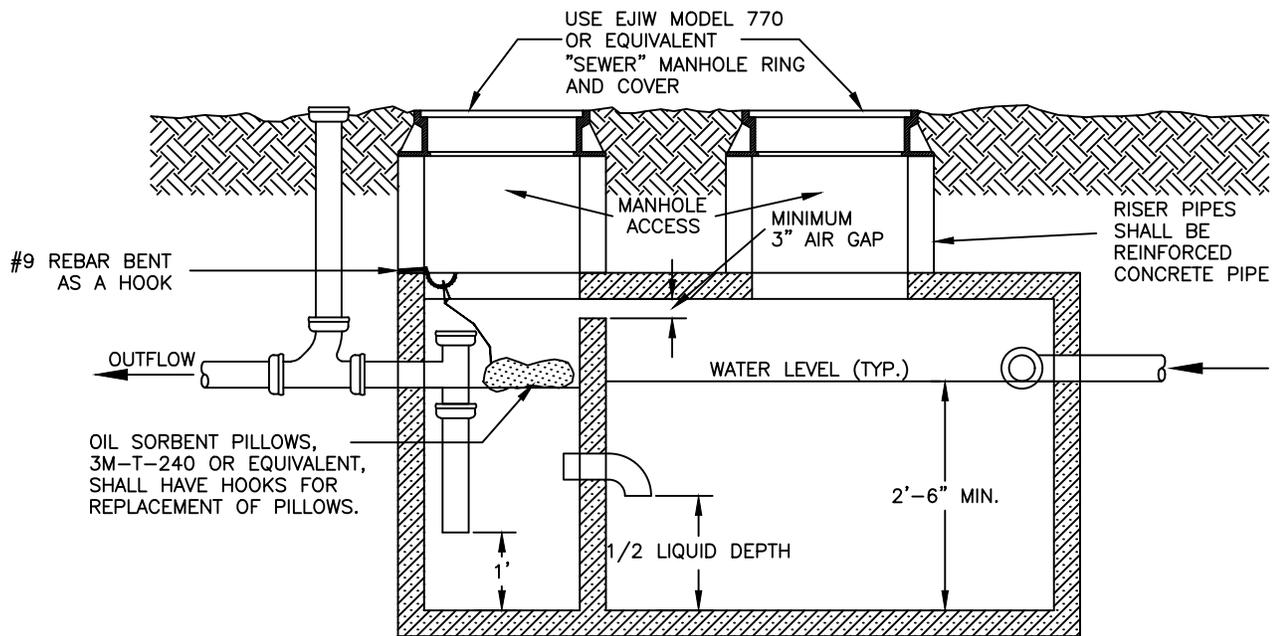

SECTION – FOR EXTERNAL USE

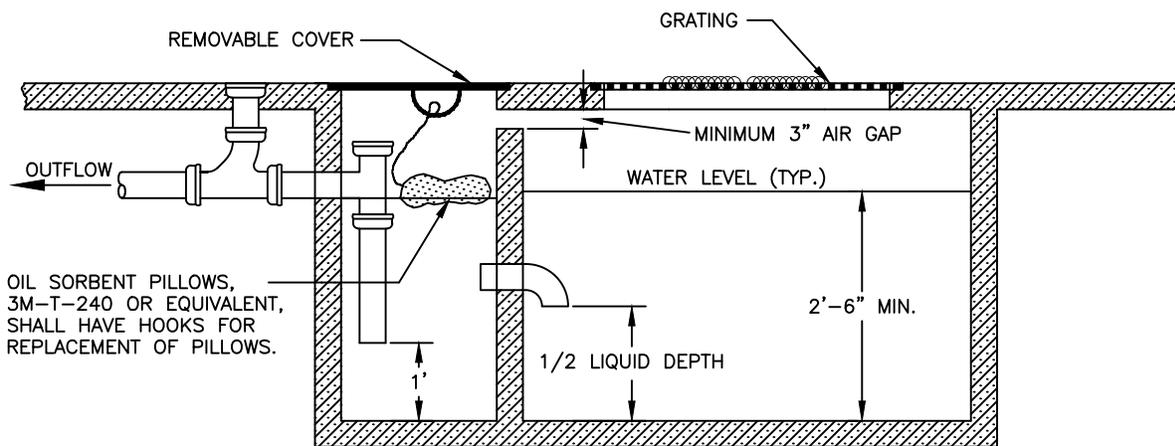

SECTION – FOR INTERNAL USE

1. HOGS WASTEWATER INTERCEPTOR SIZE, ALL RELATED PIPING, ALL CONNECTIONS AND APPURTENANCES SHALL BE IN ACCORDANCE WITH THE UNIFORM PLUMBING CODE (UPC) – UTILIZING MOST CURRENT VERSION, REVISION, ADDENDUM AND / OR SUPPLEMENT.
2. HOGS WASTEWATER INTERCEPTOR MINIMUM SIZE SHALL BE ONE THOUSAND (1000) GALLONS FOR EXTERIOR INSTALLATIONS OR SIZED AS PER CURRENT PLUMBING CODE FOR INTERIOR INSTALLATIONS.
3. HOGS WASTEWATER INTERCEPTOR SHALL BE VENTED THROUGH STRUCTURE SERVED / SUPPLYING WASTEWATER, WHEN / WHERE APPLICABLE.
4. HOGS WASTEWATER INTERCEPTOR MANHOLE FRAMES, LIDS / COVERS, INSPECTION PORT(S) AND CLEANOUT(S) RECOMMENDED TO BE GAS-TIGHT (SEALED).
5. HOGS WASTEWATER INTERCEPTOR LOCATED WITHIN THE PATH OF MOTOR VEHICLE TRAVEL SHALL HAVE TRAFFIC BEARING (RATED) FRAMES, LIDS / COVERS, INSPECTION PORT(S) AND CLEANOUT(S).



Engineering Division

Hydrocarbons, Oil, Grit and Sand (HOGS) Wastewater Interceptor

Approved By
City Engineer
Kevin J. Slovarp

Adopted: 02/1990
Revised: 09/28/2020

STD - 530