


## NOTES:

1. FORCE MAIN SHALL HAVE BOTH MECHANICAL RESTRAINERS AND THRUST BLOCKS.
2. ALIGN THE 90-DEGREE BEND WITH THE CENTER OF THE GRAVITY PIPE CHANNEL.
3. ENTIRE MANHOLE, AS WELL AS TWO MANHOLES DOWNSTREAM, SHALL BE COATED WITH SHERWIN WILLIAMS DURA-PLATE 6000 OR APPROVED AS PER PUBLIC WORKS MANUAL.
4. STAINLESS STEEL LINK SEALS SHALL BE USED WHEN CORING A FORCE MAIN INTO AN EXISTING MANHOLE.

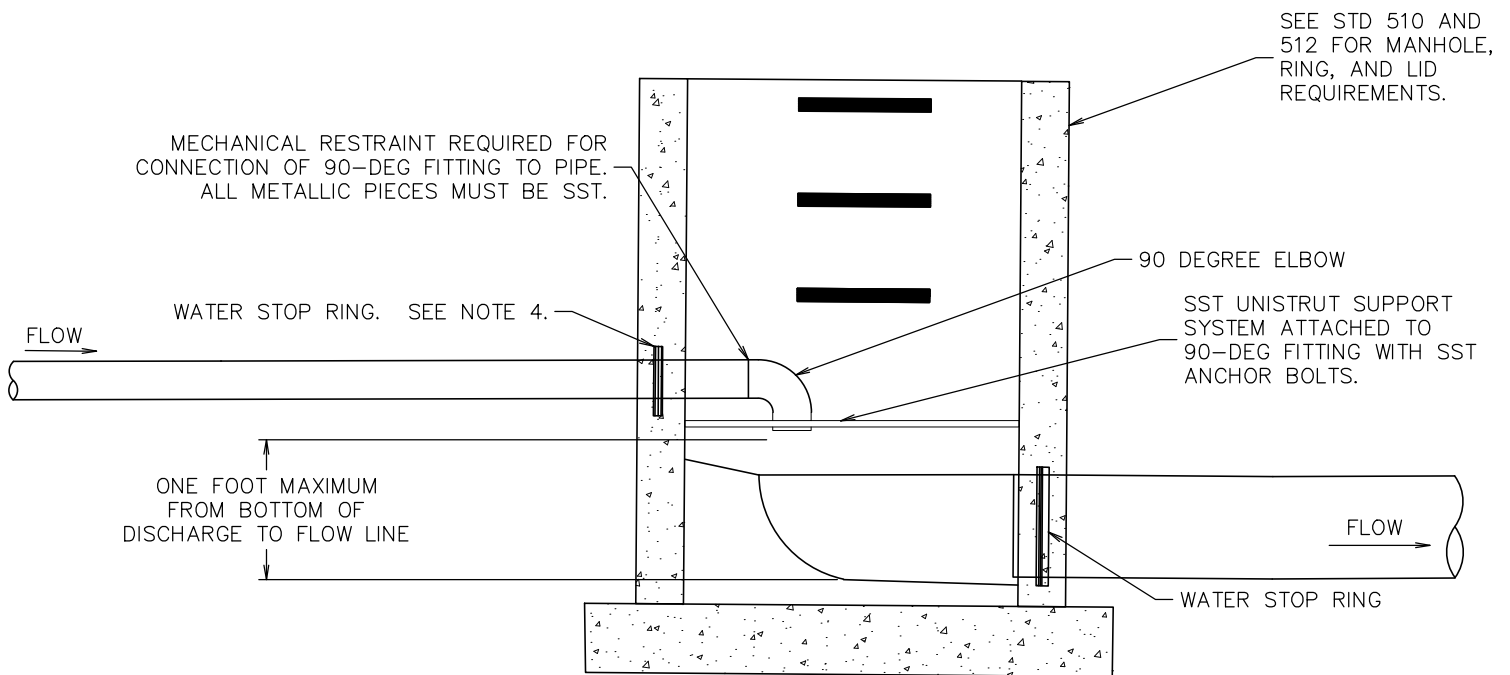

Engineering Division

## FORCE MAIN TERMINATION DETAIL

*Ross Mollenhauer*

Approved By Utility  
Project Manager –  
Ross Mollenhauer, PE

Revised: 09/28/2020

STD - 555