

Engineering Division



Accessible Front In Parking Spaces  
Access In Wide Sidewalk (Sheet 1 of 2)

*Kevin J. Slovarp*

Approved By  
City Engineer  
Kevin J. Slovarp

Adopted: 02/27/1999  
Revised: 01/13/2017

STD - 782-1

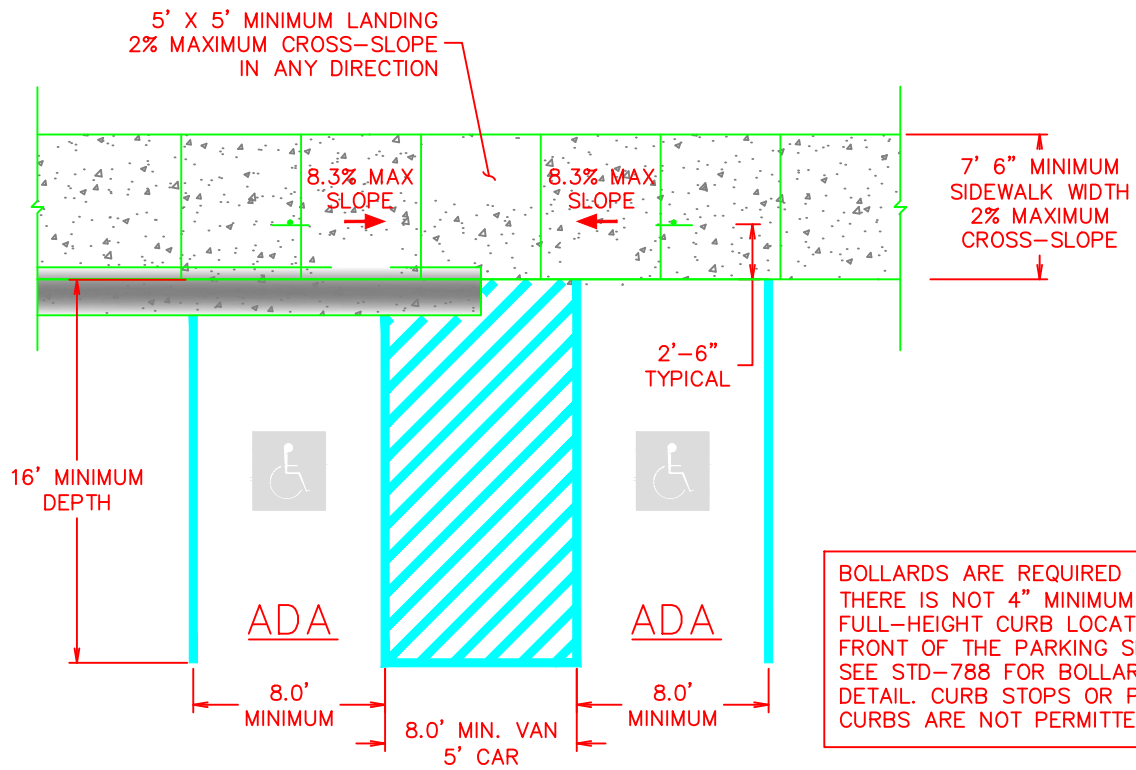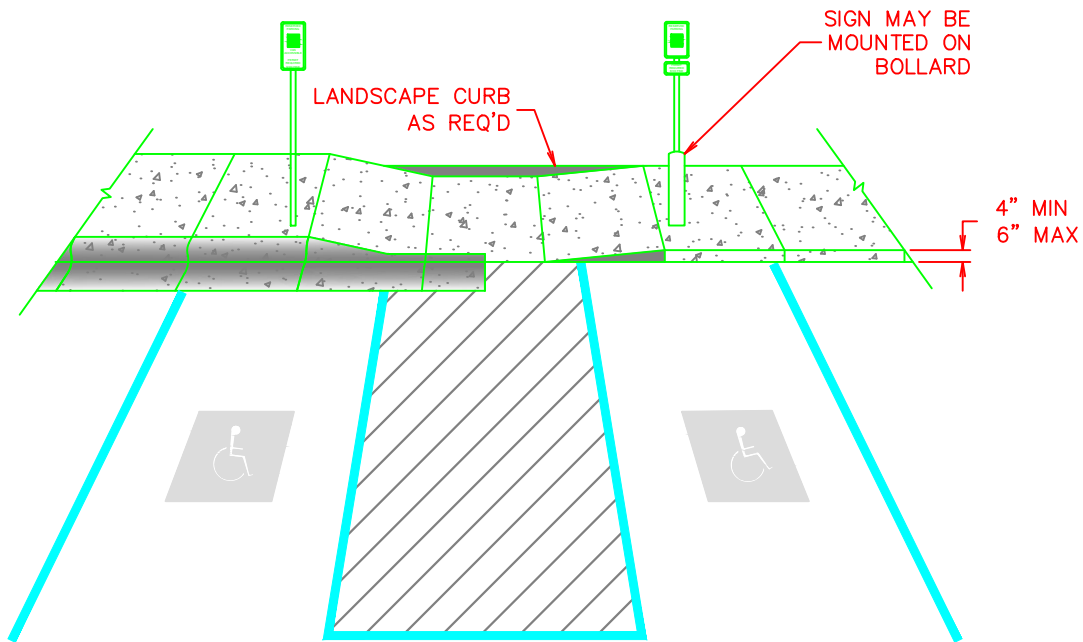

BOLLARDS ARE REQUIRED WHERE THERE IS NOT 4" MINIMUM REVEAL FULL-HEIGHT CURB LOCATED IN FRONT OF THE PARKING SPACE. SEE STD-788 FOR BOLLARD DETAIL. CURB STOPS OR PIN DOWN CURBS ARE NOT PERMITTED.



Engineering Division

Accessible Front In Parking Spaces  
Access In Narrow Sidewalk (Sheet 2 of 2)

Approved By  
City Engineer  
Kevin J. Slovarp

Adopted: 02/27/1999  
Revised: 01/13/2017

STD - 782-2