


SECTION – FOR EXTERNAL USE

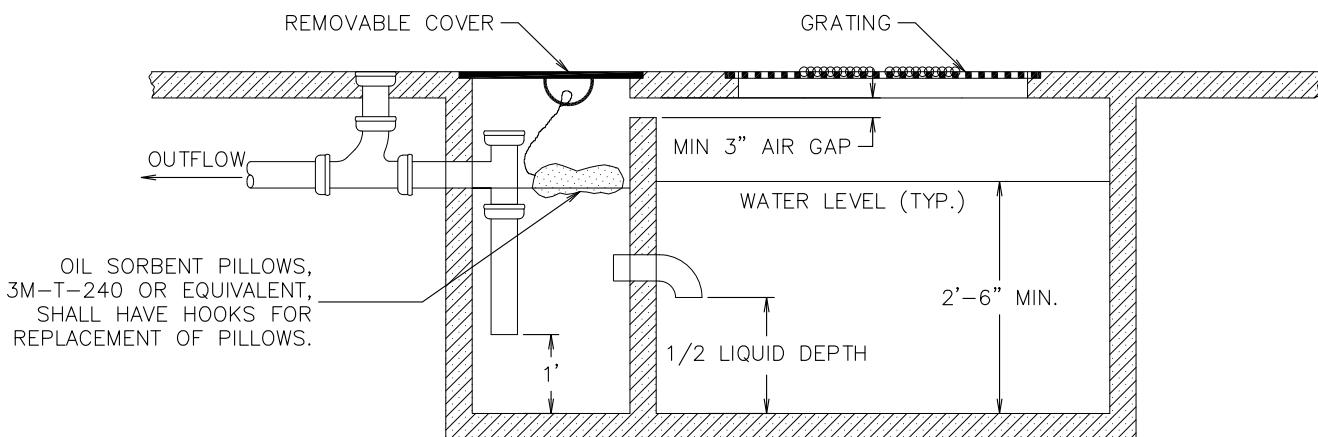

SECTION – FOR INTERNAL USE

GENERAL NOTES:

1. CONSTRUCTION MATERIALS AND PROCEDURES SHALL COMPLY WITH MONTANA PUBLIC WORKS STANDARD SPECIFICATIONS (MPWSS), 7TH EDITION, APRIL 2021, AS MODIFIED BY THE MISSOULA CITY PUBLIC WORKS STANDARDS AND SPECIFICATIONS MANUAL, APPENDIX 2-A (STANDARD MODIFICATIONS TO MPWSS), CURRENT EDITION.
2. HOGS WASTEWATER INTERCEPTOR SIZE, ALL RELATED PIPING, ALL CONNECTIONS AND APPURTENANCES SHALL BE IN ACCORDANCE WITH THE UNIFORM PLUMBING CODE (UPC) – UTILIZING MOST CURRENT VERSION, REVISION, ADDENDUM AND / OR SUPPLEMENT.
3. HOGS WASTEWATER INTERCEPTOR MINIMUM SIZE SHALL BE ONE THOUSAND (1000) GALLONS FOR EXTERIOR INSTALLATIONS OR SIZED AS PER CURRENT PLUMBING CODE FOR INTERIOR INSTALLATIONS.
4. HOGS WASTEWATER INTERCEPTOR SHALL BE VENTED THROUGH STRUCTURE SERVED / SUPPLYING WASTEWATER, WHEN / WHERE APPLICABLE.
5. HOGS WASTEWATER INTERCEPTOR MANHOLE FRAMES, LIDS / COVERS, INSPECTION PORT(S) AND CLEANOUT(S) RECOMMENDED TO BE GAS-TIGHT (SEALED).
6. HOGS WASTEWATER INTERCEPTOR LOCATED WITHIN THE PATH OF MOTOR VEHICLE TRAVEL SHALL HAVE TRAFFIC BEARING (RATED) FRAMES, LIDS / COVERS, INSPECTION PORT(S) AND CLEANOUT(S). LIDS SHALL BE TEXTURED SLIP RESISTANT WITHOUT CITY LOGO AND LABELED AS "SANITARY SEWER."



**Hydrocarbons, Oil, Grit and Sand (HOGS)  
Wastewater Interceptor**

Approved By  
City Engineer  
Kevin J. Slovarp

Adopted: 02/1990  
Revised: 01/01/2023

**STD - 530**